
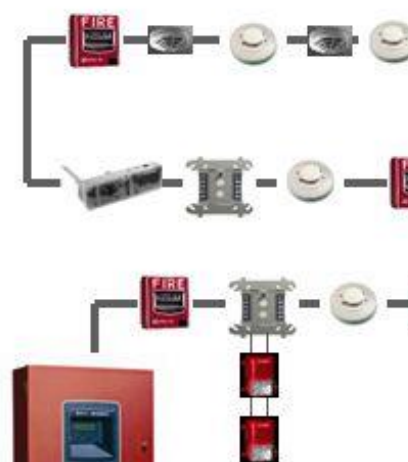


Lower wiring costs

Conventional

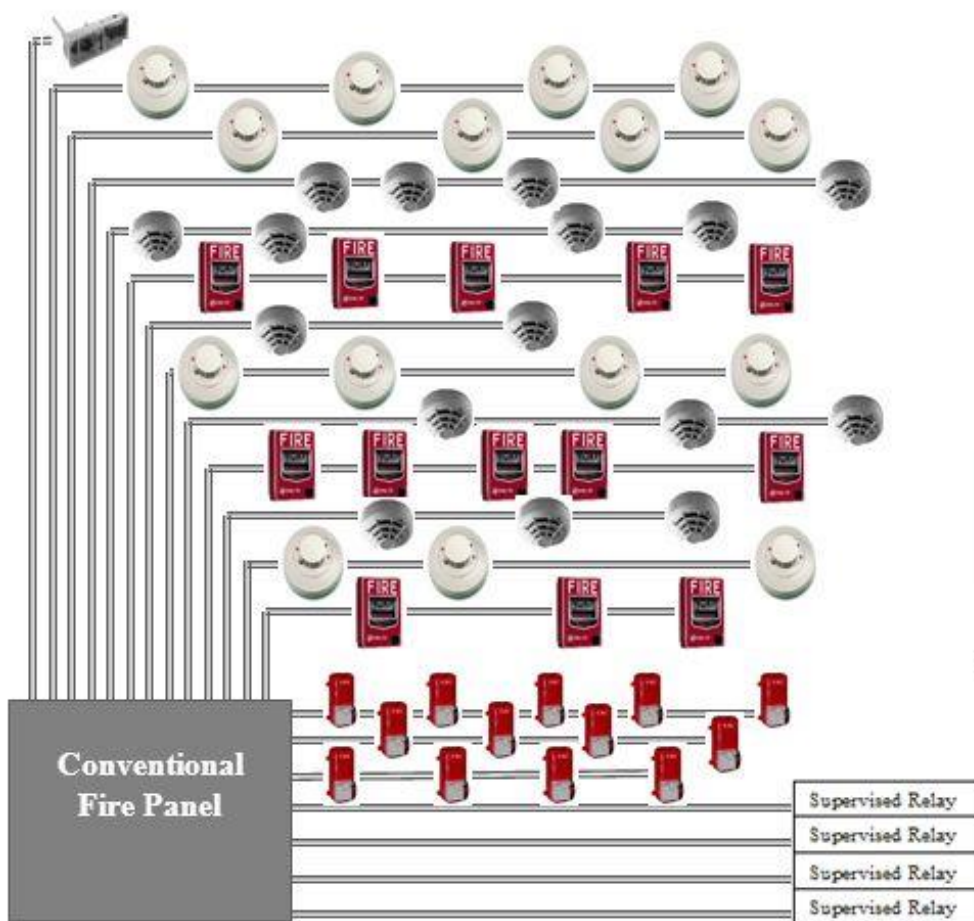


VS


Address



MS-9050UD

FIRE ALARM SYMBOLS

-  FIRE ALARM PULL STATION AT +48".
-  FIRE ALARM STROBE - +80" AFF OR 6" BELOW CEILING, WHICHEVER IS LOWER.
-  FIRE ALARM HORN/STROBE - +80" AFF OR 6" BELOW CEILING, WHICHEVER IS LOWER.

 FIRE ALARM SPRINKLER MONITOR

 FIRE ALARM ANNUNCIATOR PANEL

-  FIRE ALARM HEAT DETECTOR.
-  FIRE ALARM SMOKE DETECTOR.
-  FIRE ALARM DUCT SMOKE DETECTOR.
-  FIRE ALARM TAMPER SWITCH.
-  FIRE ALARM FLOW SWITCH.

NOTE: ALL FIRE ALARM DEVICES SHALL MEET A.D.A. REQUIREMENTS.